

ILTEC Technology – New Pathways Towards Safe and Effective Cooling

Martina Hanel, Andreas Filzwieser, Stefan Ruhs

It is the increasing demand for an economic and cost saving operation mode that requires effective cooling in order to achieve low refractory wear and good furnace lifetime, which is making cooling technology an important aspect of furnace operation. In addition, safety awareness is becoming more and more a focal point of the operating philosophy. However, the use of water – today's standard cooling medium – has major drawbacks as it can cause problems during furnace start up and operation, namely hydration problems, corrosion and explosion. Not to forget the severe personal as well as economical damage in case of a malfunctioning water cooling system. With the new patented cooling technology ILTEC it is possible to overcome

the disadvantages of water by using an alternative cooling medium, namely the ionic liquid IL-B2001. The main characteristics, which make IL-B2001 so favourable, are a neglectable vapour pressure, the absence of explosion, the wide liquidus range and the operation temperature from 50 to 200 °C and the non-flammable, non-corrosive and atoxic behaviour. All those properties lead to many areas of application, which can contribute to accomplishing a water-free production route for the entire metal processing industry.

Keywords:

Cooling solutions – Water free cooling – Ionic liquid – Improved safety

ILTEC Technologie – Neue Wege zur sicheren und effektiven Kühlung

Durch die stetig weiter wachsenden Anforderungen an eine möglichst wirtschaftliche und kostensparende Betriebsweise sind eine effektive Kühlung und ausgereifte Kühltechnologien unabdingbar um niedrigen Feuerfestverbrauch bzw. hohe Ofenlebensdauer zu erreichen. Zusätzlich rücken Sicherheitsaspekte mehr und mehr in den Fokus. Die Verwendung von Wasser – das heutzutage meistverwendete Kühlmedium – hat in diesem Zusammenhang viele negative Eigenschaften, beginnend bei Problemen während des Aufheizens und der Inbetriebnahme durch Hydratation über Korrosionsprobleme bis hin zu schwerwiegenden Explosionen im Fall einer Fehlfunktion oder Leckage. Mit der neuen und patentierten Kühltechnologie ILTEC ist es möglich, durch ein alternatives Kühlmedi-

um, die ionische Flüssigkeit IL-B2001, viele der negativen Eigenschaften von Wasser zu umgehen. Die wichtigsten Eigenschaften, welche IL-B2001 auszeichnen, sind der vernachlässigbare Dampfdruck, das völlige Ausbleiben von Explosionen sowie der breite Anwendungsbereich von 50 bis 200 °C. Zusätzlich ist IL-B2001 nicht entflammbar, nicht korrosiv und nicht giftig. All diese Eigenschaften führen zu einer breiten Palette an – teilweise bereits realisierten – Anwendungen die dazu beitragen können eine wasserfreie Produktionsroute für Metalle zu verwirklichen.

Schlüsselwörter:

Kühlösungen – Wasserfreie Kühlung – Verbesserte Sicherheit – Ionische Flüssigkeiten

Technologie ILTEC – Nouvelle approche vers une réfrigération fiable et effective

Tecnología ILTEC – Nuevos caminos hacia la refrigeración segura y eficiente

1 Introduction

The productivity and output of industrial operating metallurgical processes has been dramatically increased over the last decades, partly owned by applying more and more effective cooling solutions. For the metallurgical performance but especially for an economical success of a plant the availability and the lifetime of each reactor is of great importance. However, the limiting factors of furnace availability might be manifold. Oftentimes, they can be related to high refractory wear in areas like slag zone or tapping areas. Other areas experiencing severe corrosive attack can also cause a decrease in performance and lifetime [1-3].

Water as the conventional cooling medium for gaining an increase in refractory lifetime is very risky in certain areas since a leakage would result in an immediate explosion causing severe damage within the furnace structure. A best-case scenario would be a production loss as a consequence of major repair work whereas, as a worst-case scenario, personal injury and fatal accidents have a high probability. Known accidents from all over the world in all different areas where water is used as a cooling medium are evidence of this fact. However, now there is an effective and yet water-free alternative available, the approach of employing an ionic liquid as cooling medium – the ILTEC Technology.

With the novel ionic liquid cooling technology virtually all negative effects of a water cooled system are eliminated and additional benefits can be provided. By definition, ionic liquids (IL) are salts with a liquidus temperature below 100 °C. Furthermore, they have no noticeable vapour pressure below their thermal decomposition point and – depending on the actual composition – there is just a minor or absolutely no reaction with liquid melt or slag.

These fundamental advantageous qualities were utilized for designing the special ionic liquid IL-B2001, which can operate as a cooling medium within a temperature range of 50 °C up to 200 °C. This broad operating temperature range and the total absence of explosive reactions, beside all other positive effects like non-corrosiveness, non-toxicity and non-flammability, make IL-B2001 a most welcome cooling medium. In addition, the high temperature can be used for the recovery of heat and energy and additional benefits resulting from this relatively high cooling medium temperature are the avoidance of hydration and corrosion problems.

This special cooling medium is the core part of the ILTEC Technology, which is described herewith in detail. Since the technology of cooling with ionic liquids is new, there are certain elements afflicted with uncertainties and yet the possibilities of the technology are not fully understood. Within this paper it is intended to create an awareness about the chances and opportunities which can be realized by the application of the ILTEC Technology.

Overall it is of utmost importance for industrial applications that the requirements regarding critical heat flux, thermal limits and impacts of health, safety and environment have to be fulfilled. In order to eliminate concerns and highlight potentials, major data of the ionic liquid IL-B2001 for cooling are provided and discussed. Furthermore, already realized reference projects are described and ideas for possible future application fields are presented.

It is the unique characteristics of the ionic liquid IL-B2001 combined with an optimized and holistic cooling solution that can lead to an industrial change regarding new pathways towards safe and effective cooling.

2 IL-B2001 – the ionic liquid at a glance

In general, ionic liquids are salts meaning they consist solely of anions and cations. Per definition, ionic liquids show a melting point below 100 °C; many of them are liquid even at room temperature, caused by their poorly coordinated ions [6-8]. Dislocated charging and one ion based on an organic molecule avoid the formation of a stable crystal lattice, so that only a minor amount of thermal energy is required to conquer the lattice energy and break the crystal lattice. Varying the cations and anions allows designing ILs with different properties (e.g. melting point, viscosity and solubility).

For the cooling application, the ionic liquid IL-B2001 was exclusively designed as a medium for meeting the typical requirements for this application. Especially the high operation temperature and the broad temperature range have to be highlighted. The properties are summarized in Table 1.

Table 1: Characteristic properties of IL-B2001

| | Symbol | Value | Range |
|----------------------------------|----------|-----------|---------------------|
| Operating temperature [°C] | | 50-200 | $\Delta T = 150$ °C |
| Short term stability [°C] | | 250 | |
| Decomposition temperature [°C] | | 450 | |
| Crystallization temperature [°C] | | <15 | |
| Density [kg/dm ³] | ρ | 1.25-1.14 | 50-200 °C |
| Heat capacity [J/gK] | c_p | 1.38-1.70 | 50-200 °C |
| Electrical conductivity [mS/cm] | κ | 30-130 | |
| Dynamic viscosity [mPa·s] | η | 20-5 | 50-100 °C |

3 Properties, opportunities and differences from the state of the art

Beyond the above given data and numbers, the ionic liquid IL-B2001 has attributes different to many of the state of the art cooling media. The following sections provide an overview about the most essential characteristics.

3.1 Non explosive

Whenever the decomposition temperature of 450 °C is reached and exceeded, the ionic liquid will completely decompose into its gaseous components. In order to demonstrate that there is no explosive reaction occurring when IL-B2001 gets in contact with hot liquid melt, tests have been performed at industrial scale operating furnaces. The ionic liquid was brought in contact with molten copper (at 1250 °C) as well as liquid steel (at 1750 °C) by pumping it beneath bath level with a lance. In both instances it could be seen that there is virtually no reaction. Only slight bubbling of the melt was apparent.

3.2 Non corrosive

An essential characteristic of IL-B2001 is its chemical composition and the production procedure. A special and patented production process ensures that this ionic liquid is free of any chlorine. As a direct consequence IL-B2001 can be employed as a coolant in every conventional cooling element and most of common sealing materials. A variety of materials (steel grades, copper, aluminium and nickel-base alloy) have been tested at room temperature but also at higher temperatures comparable to the maximum operation temperature. Different construction and piping materials were brought in contact with the ionic liquid for 30 days and at temperatures of 200 °C and 250 °C. All results showed only a negligible weight loss indicating high corrosion resistance. These results are meanwhile proven at an industrial scale installation where the ionic liquid is used since more than 17 months at operation temperature between 150 °C and 180 °C. Ever since the start-up there is no corrosion at the furnace shaft wall at all.

3.3 Non-flammable

When comparing the ionic liquid with thermal oils, as an example of an alternative cooling medium, in particular the different characteristic at high temperatures has to be em-

phasized. Some thermal oils are defined as non-flammable. However, once the oil temperature reaches and exceeds its ignition temperature it starts to burn and burning cannot be stopped even when the heat source is removed. This is in stark contrast to the behaviour of IL-B2001. Once the heat source is removed the decomposition stops immediately.

3.4 Non-toxic, not harmful

Since the ionic liquid is used at industrial scale in plants, an uncomplicated handling and simultaneously guaranteeing health and safety of the operators is strongly desired. In this context, all the information is collected and described in the manual as well as the technical and safety data sheets and can be summarized as follows. The ionic liquid is REACH certified. It is classified as a non-dangerous good and can be stored and transported without any special restrictions except preventing contact with water and open atmosphere. It shall not be classified as acutely toxic, the hazard class and category is 2, meaning skin irritating.

IL-B2001 shall not be classified as hazardous to the aquatic environment but it is not biodegradable.

3.5 Broad operation temperature range

The operation temperature of 50 to 200 °C and hence the temperature difference between inlet and outlet temperature of up to 150 °C is advantageous in terms of heat recovery as well as operational practice.

Cooling within this temperature range enables an adjustable intensity of cooling. A higher cooling element temperature can prevent the condensation of water vapour and, as a direct consequence, can minimize the risk of refractory hydration during heating up or due to leakages. Furthermore, a sufficiently high cooling element surface temperature avoids the formation of condensed corrosive compounds and dew point corrosion, respectively.

The fact that the IL-B2001 allows an outlet temperature of up to 200 °C makes the process suitable to be combined with a heat recovery system for direct usage or power generation under feasible conditions. This high absolute temperature and the extensive temperature range permits a heat recovery in an efficient way rather than being lost (creating steam instead of warm water). In case of continuously provided heat the possibility of heat recovery through an Organic Rankine Circle (ORC) exists, which is a technology not suitable for water as cooling medium. Under these circumstances primary energy resources can be saved.

3.6 Heat removal and specific heat capacity

Considering properties like heat capacity, heat transfer coefficients, Reynolds number and Prandtl number, it may be assumed that the amount of heat removed is less compared to a water cooled system. But comparing an IL-B2001 cooled application with the same application cooled by water, the entire system has to be considered as one. Figure 1 shows a schematic picture of a copper cooling element including the different parts such as copper cooler, cooling medium,

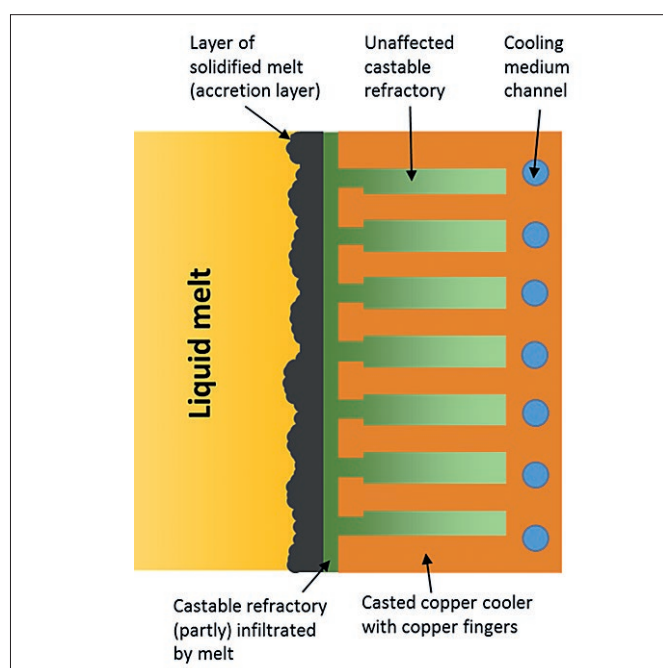


Fig. 1: Schematic picture of the entire cooling system (high intensity cooling with a freeze lining concept)

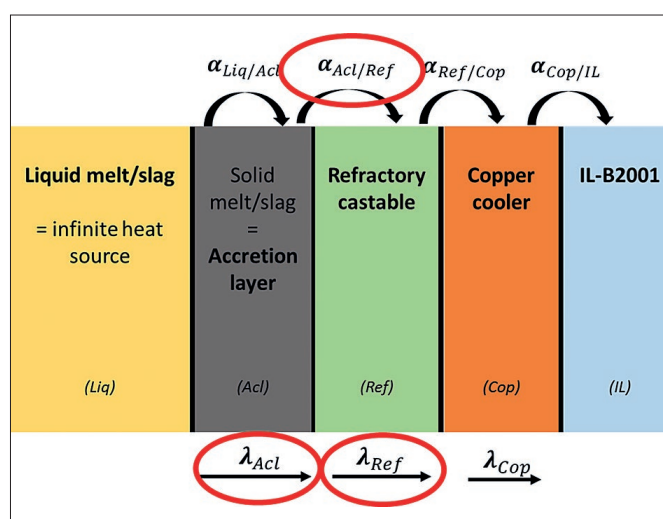


Fig. 2: Limiting factors for heat transfer for the system as given in Figure 1

castable refractory, solidified melt/slag and the liquid melt. According to Figure 1, Figure 2 shows the heat transfer coefficients ($\alpha = \text{W}/\text{m}^2\text{K}$) and thermal conductivities ($\lambda = \text{W}/\text{mK}$) within the different layers melt/accretion layer/refractory/copper cooler/cooling medium. The amount of heat which will be removed from the melt depends on the heat transfer coefficients between melt and accretion layer, between accretion layer and refractory, between refractory and copper and between copper and ionic liquid. Also the thermal conductivity of the melt, the accretion layer, the refractory, the copper and again from the IL-B2001 are influencing the amount of heat removed from this system.

It is known from calculations as well as lab scale tests, that the limiting factor for sufficient heat transfer are the thermal conductivity of the accretion layer and the refractory as well as the heat transfer coefficient between accretion layer and refractory (marked red in the picture). The lim-

iting factor is neither the heat transfer coefficient between copper and IL-B2001 neither the thermal conductivity of the IL-B2001. Generally speaking, a defined amount of heat will be transferred to the cooling medium and will be removed, independently of the cooling medium itself.

Considering the basic equation for heat flux (Equation 1)

$$\dot{Q}[\text{W}] = \dot{m} \left[\frac{\text{m}}{\text{s}} \right] \cdot c_p \left[\frac{\text{J}}{\text{gK}} \right] \cdot \Delta T[\text{K}] \quad (1)$$

it can be derived that at the same cooling medium velocity the lower heat capacity value (c_p) compared to water (c_p for water is 4.17 J/gK) will result in a higher temperature. However, this fact can be compensated by the achievable higher temperature difference (typically 15 – 20 °C in case of water but up to 150 °C for IL-B2001). Also the higher density of IL-B2001 compared to water helps balancing the equation towards the same value for Q .

On the other hand, an increase in cooling medium velocity will also lead to a heat removal at the same ΔT .

A direct comparison between water and IL-B2001 as the cooling media within a given system was conducted with CFD (Computational Fluid Dynamics) modelling. A special designed copper cooling element was taken into account. The geometry is given in Figure 3 and it can be seen that only very small distances away from the hot side the temperature within the refractory material is steeply decreasing. It can also be seen that the temperature distribution is very homogeneous throughout the surface.

The calculation of the removed heat from this copper cooling element at a melt temperature of 1600 °C revealed that with this concept the heat removal is sufficient and the system is capable of creating a freeze lining. Compared to water, at the same boundary conditions, the difference of removed heat per square meter is lower for IL-B2001 at less than 3 %. This difference is a result of the different material properties for water and IL-B2001, namely Reynolds number, Prandtl number, dynamic viscosity and others.

3.6.1 High electrical conductivity

Since the ionic liquid is per definition a salt and hence consisting of cations and anions the electrical conductivity is several orders of magnitude higher compared to water.

This restricts the application of substituting water within induction furnaces or wherever a low electrical conductivity is required. To overcome this issue within induction furnaces a special design of the cooling circuit has to be considered.

3.6.2 No altering, non-consumable

In contrast to other cooling media, IL-B2001 shows no ageing phenomena whenever the cooling circuit is closed and the liquid does not get in contact with water or open atmosphere. This makes it a non-consumable good.

4 ILTEC technology – hardware and features

A fundamental characteristic of ILTEC is the application of a closed circuit loop for the ionic liquid – the primary cooling circuit. The prevention of any contact between the ionic liquid and water and/or air makes IL-B2001 not a consumable, as mentioned before. Experiences over the last years has proven that IL-B2001 does not change its originally properties provided. The basic design and required equipment of the ILTEC cooling technology remain more or less the same for each application whereas the details, especially the supply capacity of the cooling medium and the dimensioning of the component parts, are individually tailor-made to meet customer-specific demands.

An exemplary design of an ILTEC facility is given in Figure 4 and the main components thereof can be summarized:

- tank filled with IL-B2001, the freeboard volume above the liquid level is purged with nitrogen to prevent absorption of water through moisture in the air,
- two identical pumps (one for redundancy in case of breakage or malfunction) guarantee the flow of the IL through the entire pipe system,
- two heat exchangers for removing the heat to the secondary cooling circuit, again one in operation, one for redundancy,
- numerous measuring devices (digital as well as analogue) throughout the entire system to measure temperature, flow, pressure and differential pressure,
- variety of valves, adjusting wheels and shut-off devices for all different operation modes,

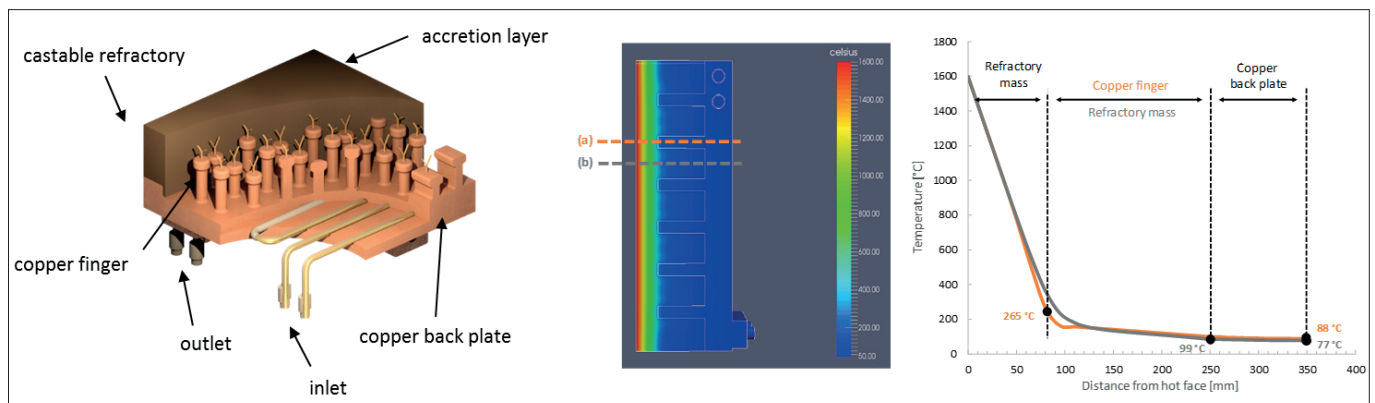


Fig. 3: Special design of a composite furnace module cooling (CFM) element for creating a freeze lining (left) and CFD modelling of the temperature distribution at a furnace temperature of 1600 °C (middle) and resulting steep temperature gradient within the refractory mass (right)

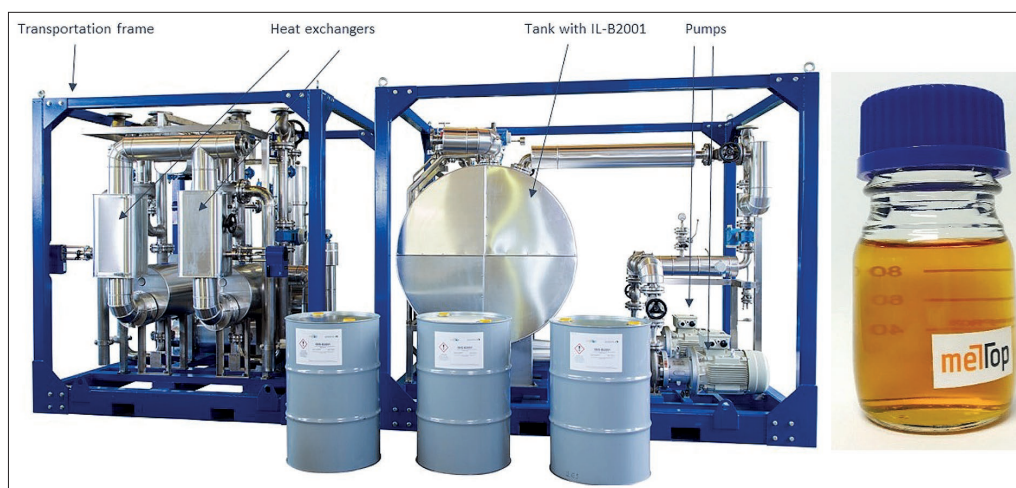


Fig. 4: Basic design of an ILTEC system as installed at ArcelorMittal Bremen GmbH in Germany (left) and photo of the optical appearance of the ionic liquid IL-B2001

- depending on the application additional cooling circuits can be implemented.

5 Out of the box

With all the described facts, properties and advantageous of the ionic liquid IL-B2001 and the ILTEC Technology, an immense field of possible applications opens up. Beside the already realized projects there is an excerpt of the numerous future possibilities ILTEC has to offer.

5.1 New safety standards – becoming Best Available Technology (BAT)

It is a sad reality that from time to time accidents do happen in the metallurgical industry as well as in any other industries facing hot temperatures combined with water as the cooling medium. When replacing water by IL-B2001, it is its superior properties resulting in an explosion free environment that allows cooling in a safe and sound manner.

The diagram in Figure 5 show the path of becoming best available technology [5,9]. However, the fact that accidents and incidents might happen cannot be changed, the likelihood of an accident remains at the same level (cf. level of the grey and orange dot). But in the actual case of an

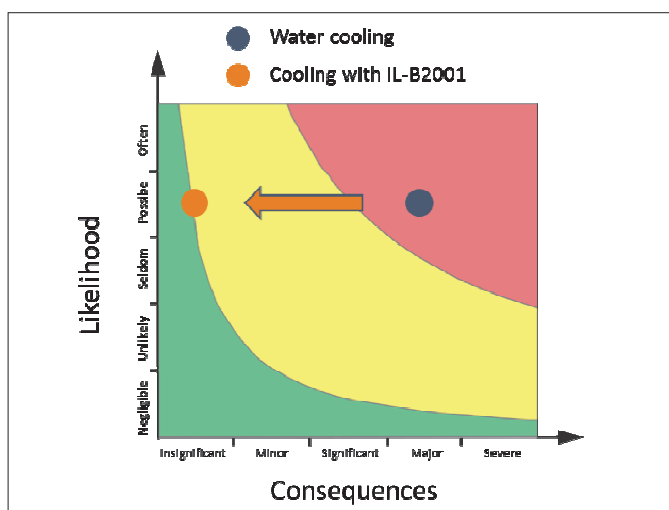


Fig. 5: Improvement of safety demonstrated within a 2-dimensional risk analysis diagram

accident, the extent of consequences can be tremendously shifted towards a decreased impact.

5.2 Tap hole cooling – new safety standards at ArcelorMittal, Bremen, Germany

Every tapping area is a highly stressed furnace section mainly due to the intense heat given off by the hot liquid phase as well as of its erosive behaviour during material discharge. In addition, the temperature variation in-between each furnace cycle is a major stress on the refractory lining. The mechanical stress and erosion results in a high wear of the tap-hole refractory and for increasing the lifetime, tap holes are partially water cooled.

At ArcelorMittal Bremen GmbH in Germany a water cooled tap hole was converted and equipped with an IL-TEC system by Mettop in order to increase safety. This system is running since autumn 2015 at a blast furnace in Bremen. Figure 6 shows the geometry and the calculated temperature distribution during tapping.

5.3 Shaft furnace wall cooling – eliminating corrosion problems at Nyrstar, Norway

One benefit of using a cooling medium at a temperature of up to 200 °C is the possibility of adjusting the operation temperature with the refractory lining to some extent. This

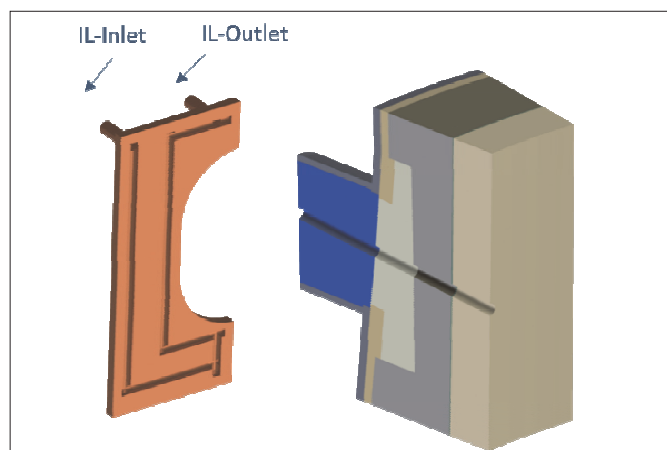


Fig. 6: Special design of the cooled tap hole with the copper cooled back plate mounted upon the steel shell

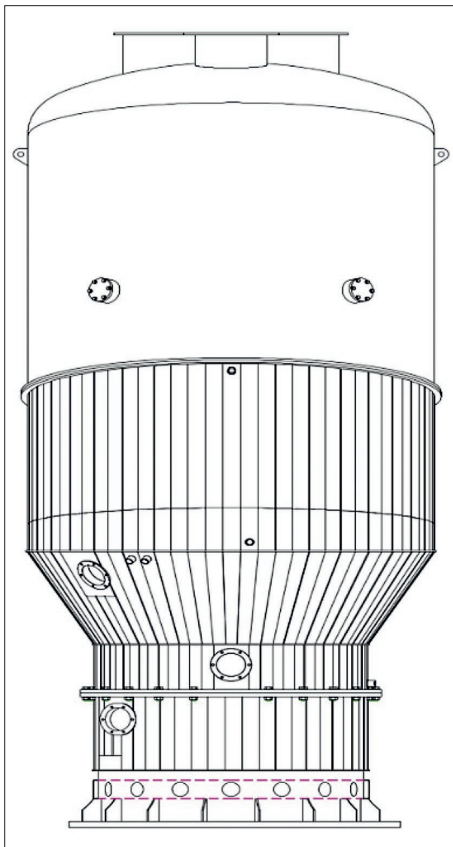


Fig. 7: Construction drawing of the shaft furnace where cooling of the lower part of the shaft is realized with ILTEC Technology

helps wherever problems arise with hydration or corrosion due to surface temperatures below the dew point.

One well known problem in non-ferrous metallurgy is the formation of sulphidic acid in the off-gas of sulphur containing raw material processing aggregates. Depending on the composition, prevailing water vapour and sulphur content, as well as the temperature and the pressure profile a certain amount of formed acid is ascending. There the gas might come in contact with the cooled side wall and might be cooled down to temperatures below the dew point where the acidic vapours start to condensate as sulphuric acid on the refractory material or steel shell – causing a very accelerated material destruction through corrosion.

The installation of cooling the furnace walls of a plasma furnace was completed at the beginning of 2015 and is in operation at Nyrstar in Hoyanger, Norway. A construction drawing of the furnace as installed in Nyrstar is given in Figure 7. Due to a changed of the input material mix, water as cooling medium resulted in equipment corrosion due to temperatures below the dew point of sulfidic acid. This circumstance could be perfectly eliminated by replacing water with IL-B2001. The implementation of an inlet/outlet temperature of 150/180 °C led to a total absence of corrosion ever since the commissioning in January 2015.

5.4 Breakthrough approaches for increasing furnace availability – cooling beneath bath level

Since ILTEC provides an absolutely safe way of efficient cooling, cooling solutions can be considered in areas where so far no cooling was imaginable. All areas beneath bath level, either beneath slag level of liquid melt, can be considered for applying an optimized solution combining refractory, cooler and IL-B2001. In Figure 8 there are three possibilities shown for the application of high intensity CFM coolers (EAF side wall (a) and tuyere zone of a Peirce Smith converter (b)) and plate coolers for a purging (for anode furnace(c)).

5.5 Cooling of offgas systems – adjustable cooling and heat recovery

For preventing corrosion problems a variety of different off gas duct designs can be cooled with IL-B2001 instead of water. With the implementation of ILTEC two advantages can be combined: on one hand, there are often corrosion problems within the off gas ducts caused by the temperature decrease during downtime. Water as cooling medium is cooling the duct to a high extent and off gas temperature might fall below the dew point of different corrosive media within the offgas (sulphur containing components, ...). Condensation of parts of the off gas will lead to corrosion and less availability of the off gas duct.

For preventing this phenomenon the operation of a higher inlet and outlet temperature at or above 180 °C of the

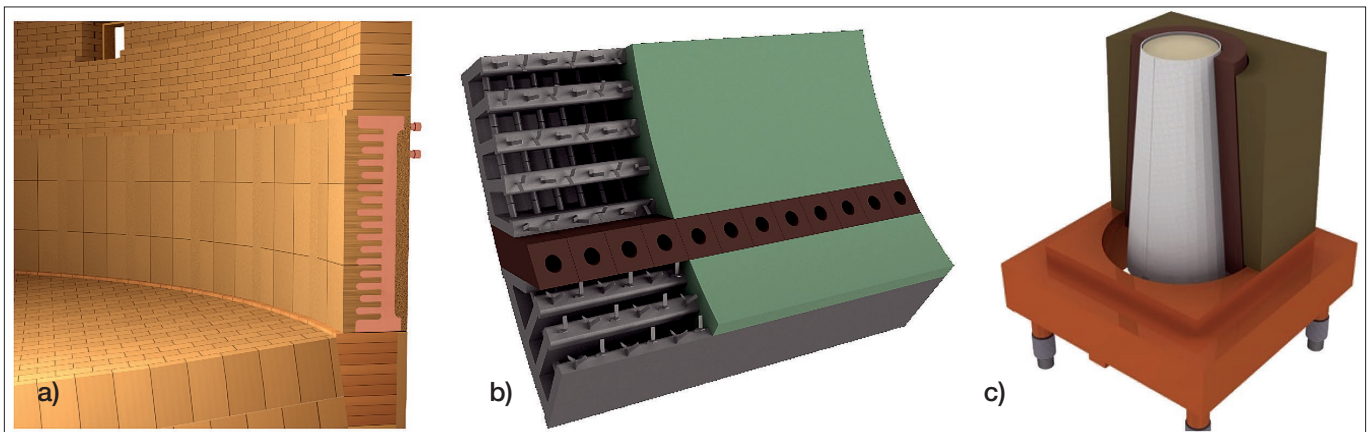


Fig. 8: Three examples of a breakthrough way to increase furnace availability by cooling beneath bath level: High intensity cooler within the lining of side wall of an electric arc furnace (a), cooling concept of tuyere zone in a Peirce Smith Converter (b) and cooling of a purging plugs in an anode furnace (c)

cooling medium will prevent condensation of water vapour or acidic components.

On the other hand, with an increase of the cooling medium outlet temperature to about 200 °C, this energy can perfectly be used for heat recovery.

6 Change of an industry – summary and outlook

The present pages describe the opportunity to increase furnace safety and operation efficiency by a commercially proven alternative cooling method. In addition, it substantially improves the operation economically by increasing life time of refractory lining and the potential of heat recovery.

The described examples demonstrate that it is possible to employ the new cooling technology as an alternative replacing water in existing cooling circuit for different reasons. The replacement of the water in a tap hole is more or less driven exclusively by safety considerations. The approach of replacing the water in the side wall cooling combined with a new design of the cooler of an electric arc furnace (for example) is driven by the increase in lifetime of the refractory and an increase in furnace availability.

This technology is however not only limited to these mentioned applications but could be used in multiple other application where cooling with water is not possible mainly due to safety reasons and become best available technology (BAT) in the future.

One important future trend in terms of a cost efficient and environmentally friendly operation mode is inevitably leading towards better methods of using waste heat. The higher outlet temperature and higher temperature difference between inlet and outlet make IL-B2001 the perfect available cooling medium for effective heat recovery. The cooling medium temperature of up to 200 °C can either be used for conversion into electricity or as direct heating.

References

- [1] VERSCHEURE, K. et al. (2006): Furnace cooling Technology in Pyrometallurgical Processes. – Sohn International Symposium: Advanced Processing of Metals and Materials, Proceedings Non-Ferrous Materials Extraction and Processing, Volume 4.
- [2] Wallner, S., Filzwieser A. & Kleicker, J. (2013): Some aspects for the use of water cooled furnace walls – Water the best refractory? – Copper Cobre Conference, November 30-December 3, 2013, Santiago de Chile, Chile; Proceedings of the Copper Cobre Conference: 667-679.
- [3] Voermann, N. et al. (1991): Furnace Cooling Design for Modern High-Intensity Pyrometallurgical Processes. – Copper 99/Cobre 99 Conference, October 10-13, 1991, Phoenix, Arizona, USA; Proceedings of the Copper Cobre Conference: 573-582.
- [4] OTERDOOM, H.J. (2014): Furnace Explosions with a Focus on Water. – COM 2014 – Conference of Metallurgists, Vancouver, Canada.
- [5] FILZWIESER, A. et al. (2014): Mettop's new Cooling Technology is the safest way to cool a Furnace. – Conference of Metallurgists, Vancouver, Canada.
- [6] JOGLEKAR, H., RAHMAN I. & KULKARNI, B. (2007): The Path ahead for ionic liquids. – Chem. Eng. Technol. No. 7.
- [7] WASSERSCHIED, P. & WELTON, T. (2008): Ionic liquid in synthesis. – Volume 1, Wiley-VCH Verlag GmbH & Co. KGaA., Weinheim, Germany.
- [8] IoLiTec: Wärmeträgermedien, Thermofluidе. – <http://www.iolitec.de/Warmespeicherung-Transport/waermetraegermedien-thermofluidе.html>, access on 20/03/2013
- [9] FILZWIESER, A., KONETSCHNIK, S. & DEYER, E. (2014): METTOP's ionic liquid cooling technology: the safest way of furnace tapping. – Furnace Tapping Conference, The Southern African Institute of Mining and Metallurgy, Johannesburg, South Africa 2014.

Dipl.-Ing. Dr. mont. Martina B. Hanel
Dipl.-Ing. Dr. mont. Andreas Filzwieser
Stefan Ruhs
All:
Mettop GmbH
Peter-Tunner-Straße 4
8700 Leoben
Austria
martina.hanel@mettop.com
andreas.filzwieser@mettop.com
stefan.ruhs@mettop.com